

DIVISION OF FIRE CODE ENFORCEMENT
ADMINISTRATIVE INTERPRETATION 7-01AM

CODE REFERENCE: Executive Regulations Number 6-06AM Section 31.

BACKGROUND: NFPA 13D, paragraph 8.6.4, add the following after garages:
“...unless located partially or wholly beneath living space.”

INTERPRETATION: It is not our intention to require complete coverage in the garage. Dry sidewall sprinklers supplied from all walls separating the garage from a heated space in order to cover the largest possible area of the garage shall be considered compliant. The garage does not require a higher density than the residence. See attached.

PREPARED BY: Tyler M. Mosman, PE

DATE April 2, 2007



FIRE MARSHAL



DIVISION OF FIRE CODE ENFORCEMENT

ADMINISTRATIVE INTERPRETATION XX-XX

EXAMPLES:

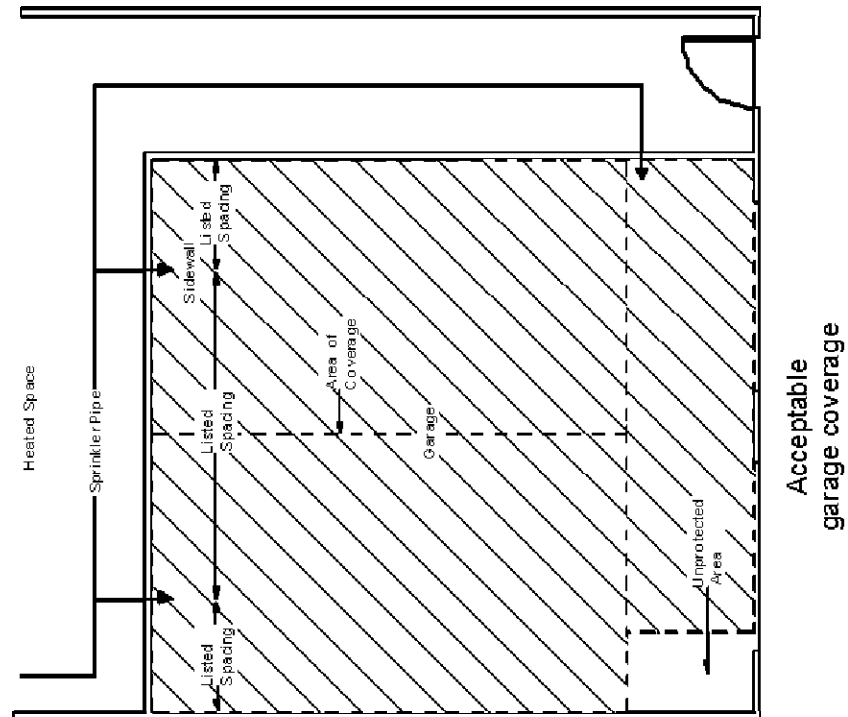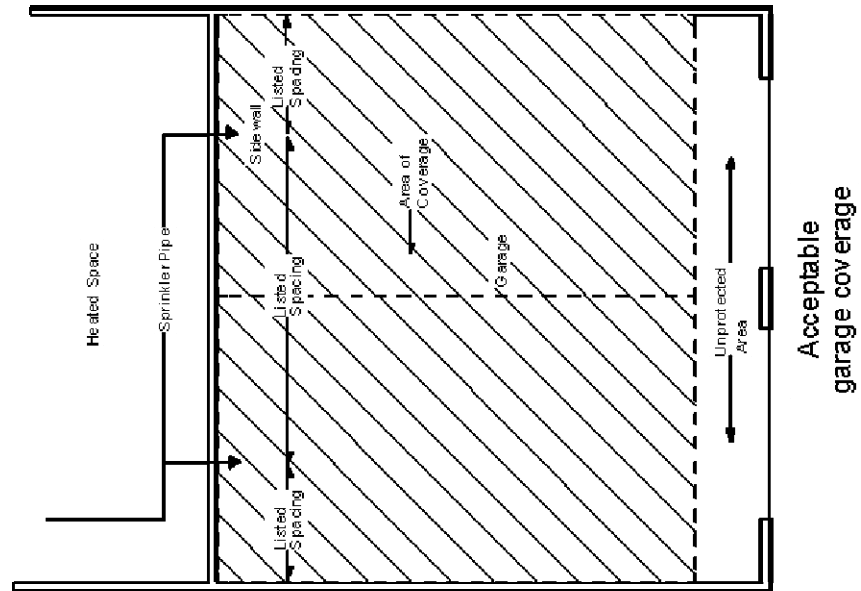

DIVISION OF FIRE CODE ENFORCEMENT
ADMINISTRATIVE INTERPRETATION XX-XX

EXAMPLES:

